

# Honeywell

## Life Safety

### PLEX-1 & PLEX-2 Overview

The following instructions should be used to properly install the PLEX-1 and PLEX-2 door option.

The PLEX door option is used in jurisdictions that require single button operation of the reset and silence functions on the fire alarm control panel. The PLEX door option protects the on-board annunciator with a UV stabilized polycarbonate clear window. Once the panel door is opened the operator can reset or silence the control panel by pressing the Reset or Silence button (no access code required).

### Compatible Control Panels

Table 1 list what cabinet P/N use which PLEX model number. Refer to the wiring diagram on the inside of the control panel door to find the Enclosure P/N.

**Table 1: Compatible Control Panel Enclosures**

Enclosure P/N	PLEX-1	PLEX-2
122723		✓
122365	✓	

### Included Parts


P/N	Qty.	Description
122826	1	UV Stabilized Clear Polycarbonate Window
122830   PLEX-1	1	Dead-front panel
or		
122828   PLEX-2		
122831	1	Metal Bezel w/mounting studs
119539	6	#6-32, 1/4" Hex Nuts
119624	4	#6-32 x 1/4" phillips zinc coated screws

### Installation Instructions

Follow these steps to properly install the PLEX door option.


#### Polycarbonate Window Installation

1. If a black plastic bezel, which ships with the control panel (see Figure 1) is already installed in the control panel door window, remove it.

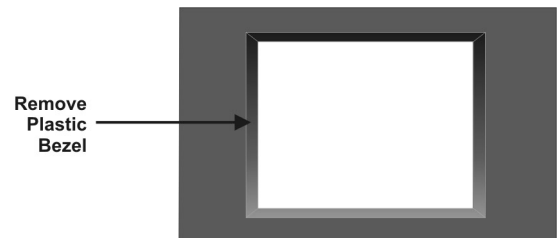

**Figure 1: Front View of Control Panel Door**

2. From the front of the control panel door insert the Plex metal bezel with the mounting studs facing the inside to the cabinet. Refer to Figure 2.

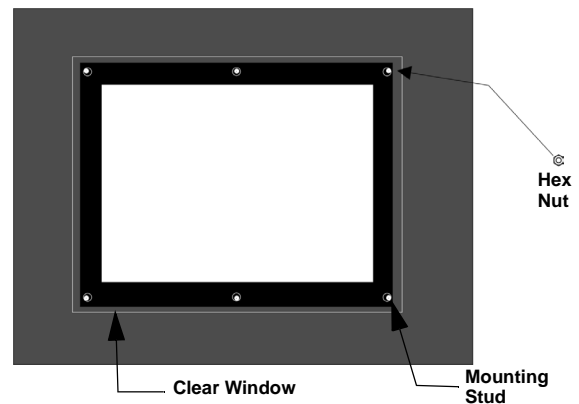

**Figure 2: Inside View of Control Panel Door**

3. From the inside of the cabinet place the polycarbonate window over the mounting studs, sandwiching the cabinet door.
4. Secure the window in place by placing the hex nuts onto the mounting studs and gently tightening them down.

## Dead-front Installation

1. Using the screws provided (P/N 119624) secure the dead-front to the cabinet as shown in Figure 3 or Figure 4.



Figure 3: Plex-2 Dead-Front Installation

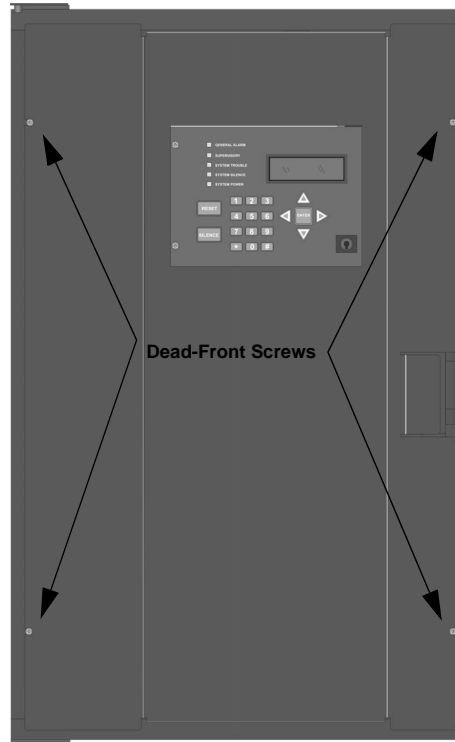


Figure 4: Plex-1 Dead-Front Installation

# Honeywell Life Safety

12 Clintonville Rd  
Northford, CT 06472-1610

© 2005 Honeywell  
P/N 151347 Rev. B, 04/05  
<http://www.honeywellfire.com>